


The



Central Lincoln P.U.D. 5000 S. 4th Street, Reedsport, OR 97467

440 Fir Avenue • Reedsport, OR 97467 • (541) 271-2181 or (541) 756-2869 • FAX: (541) 271-8729

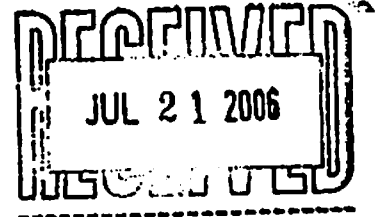

Date: July 19, 2006
To: John M Waddill, The Dyer Partnership
Subject: Lakeside Sewer Pump Station, Airport Way
From: Shirley Johnson, Sr. Engineering Technician

This will confirm your request for electrical service to the proposed sewer pump station to be located on Airport Way, Lakeside, Oregon.

In accordance with the provisions of the District's line extension and service policy, Central Lincoln P.U.D. will construct the necessary facilities to provide this service, subject to the following conditions:

1. The customer will contribute as an aid to construction the capital necessary to build the line extension. This cost has been determined to be \$25,676.00.
2. The system will serve the property with three-phase, 277/480 volt, 60 Hertz service. The service shall be metered with instrument transformers. A 13 terminal meter base is required. The CT enclosure or switchboard must have space to mount the three metering voltage transformers.
3. The customer shall obtain no right, title or interest in any of the equipment or facilities of the District by virtue of his/her contributions in aid to construction.
4. The required trenching (4' depth); installation of conduit, vaults, blown-in pullstring and backfilling shall be provided by the customer to P.U.D. specifications at no cost to the District. All materials necessary for the job to be picked up at our Reedsport warehouse.
5. The customer will provide all conduits and conductors from the transformer to the meter base.

All noted for

6. All other utilities sharing the same trench must be at least 1' above P.U.D. conduit.
7. The customer will provide adequate equipment sites and stabilize the ground around all P.U.D. equipment.
8. The customer to provide the necessary surveyed easements prior to construction.
9. This proposal is valid for 45 days from the date of this letter, and is thereafter subject to change by the District.

I hereby agree to the terms and conditions stated above for the provision of electrical service to the above referenced location

Representative for Lakeside Sewer Dist.

Date

Should any questions arise, please give me a call at (541)-271-8717. If you wish to proceed with your project please submit check or money order in the above mentioned amount along with this signed letter of agreement.

Sincerely,



Shirley Johnson
Sr. Engineering Tech

Cc: Lakeside Sewer District

JO0159112.01